

Nanofiltration and Membrane Degassing Successfully Reduce Water Hardness and Excess CO₂ from Drinking Water

Municipal water services continually utilize improved technologies so that they can offer their customers higher water quality. Water can be improved by partially softening the water, which results in lower detergent consumption and lower scaling on kitchen utensils and water fittings.

Successful trials by the municipal water services in Bad Driburg, Germany supported planning and designing the new German water plant in Alhausen with membrane treatment to soften the water.

This system was designed with nanofiltration membranes which provide water treatment without the use of chemicals. This is a big improvement over other softener techniques which require chemical injection.

In this process CO₂ gas is added in front of NF to control scaling on the membrane. In the procedure, the NF permeate is blended with small amount of UF permeate to adjust the hardness level by 50%.



An added benefit of water softening with membrane systems is that the organic material such as bacteria and viruses are also retained or filtered out of the water and the content of pesticides and nitrates are significantly reduced.

This system design also utilizes another membrane technology, 3M™ Liqui-Cel™ Membrane Contactors. These membrane contactors remove the excess carbon dioxide from the NF filtrate to the CaCO₃ dissolving capacity limitation of 5mg/L. While nanofiltration and Liqui-Cel membrane degassing technologies have been utilized for over a decade, this technology combination is a new concept in a municipal water system that makes sense.



The water treatment system was completed through the cooperation of two German companies WAT-Membratec and ATEMIS.

www.wat-membratec.com
www.atemis.net

The following table shows the main parameters and outlet values of the system.

Parameter	Value
Inlet flow rate	Up to 5.7 m ³ /h (25 gpm)
Permeate yield	75 %
Hardness before treatment	20°dH
Hardness after treatment	10°dH
Operating pressure	5.5 – 6.0 bar (80-87 psi)
Membrane area NF / UF	126 m ² (1356ft ²)/16 m ² (172ft ²)
Flux	28 l/(m ² *h)
CO ₂ -consumption	0.2 kg/m ³ (0.01 lb/ft ³)
Membrane area LMC	84 m ² (904 ft ²)
Cleaning chemicals	Not yet
Energy consumption	1 kWh/m ³ Permeate
Investment costs	115,000 € (~\$ 170,000)

Technical Brief | Nanofiltration and Membrane Degassing Successfully Reduce Water Hardness and Excess CO₂ from Drinking Water


Plant design

- CO₂ dosage for stabilization of hardness at the NF stage
- Spiral wound nanofiltration modules with internal UF permeate blending
- Set equilibrium in filtered water by removing the excess carbon dioxide using membrane contactors
- Continuous control of the water flow, yield, mixing ratio and degassing performance

Advantages

- Continuous regulation of hardness reduction while maintaining sterile water quality
- Chemical-free drinking and waste water
- Fully automated settings for drinking water demand and source water supply

For additional information, please contact your 3M representative or visit 3M.com/Liqui-Cel.

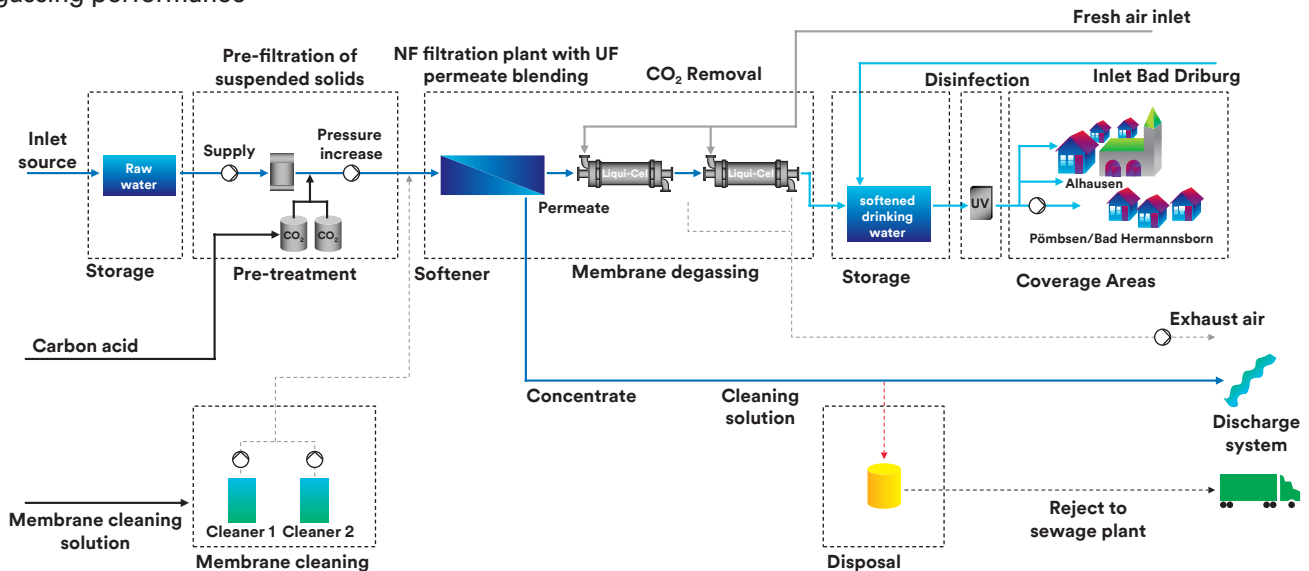

Technical Information: The technical information, guidance, and other statements contained in this document or otherwise provided by 3M are based upon records, tests, or experience that 3M believes to be reliable, but the accuracy, completeness, and representative nature of such information is not guaranteed. Such information is intended for people with knowledge and technical skills sufficient to assess and apply their own informed judgment to the information. No license under any 3M or third party intellectual property rights is granted or implied with this information.

Product Selection and Use: Many factors beyond 3M's control and uniquely within user's knowledge and control can affect the use and performance of a 3M product in a particular application. As a result, customer is solely responsible for evaluating the product and determining whether it is appropriate and suitable for customer's application, including conducting a workplace hazard assessment and reviewing all applicable regulations and standards (e.g., OSHA, ANSI, etc.). Failure to properly evaluate, select, and use a 3M product and appropriate safety products, or to meet all applicable safety regulations, may result in injury, sickness, death, and/or harm to property.

Warranty, Limited Remedy, and Disclaimer: Unless a different warranty is specifically stated on the applicable 3M product packaging or product literature (in which case such warranty governs), 3M warrants that each 3M product meets the applicable 3M product specification at the time 3M ships the product. 3M MAKES NO OTHER WARRANTIES OR CONDITIONS, EXPRESS OR IMPLIED, INCLUDING, BUT NOT LIMITED TO, ANY IMPLIED WARRANTY OR CONDITION OF MERCHANTABILITY, FITNESS FOR A PARTICULAR PURPOSE, OR ARISING OUT OF A COURSE OF DEALING, CUSTOM, OR USAGE OF TRADE. If a 3M product does not conform to this warranty, then the sole and exclusive remedy is, at 3M's option, replacement of the 3M product or refund of the purchase price.

Limitation of Liability: Except for the limited remedy stated above, and except to the extent prohibited by law, 3M will not be liable for any loss or damage arising from or related to the 3M product, whether direct, indirect, special, incidental, or consequential (including, but not limited to, lost profits or business opportunity), regardless of the legal or equitable theory asserted, including, but not limited to, warranty, contract, negligence, or strict liability.

3M and Liqui-Cel are trademarks of 3M Company. All other trademarks are the property of their respective owners. © 2021 3M Company. All rights reserved.



3M Company
3M Separation and
Purification Sciences Division
13840 South Lakes Drive
Charlotte, North Carolina
28273 USA
Phone: +1 980 859 5400

3M Deutschland GmbH
3M Separation and
Purification Sciences Division
Öhder Straße 28
42289 Wuppertal Germany
Phone: +49 202 6099 - 0

10-1061
70-2016-0229-2

Rev. 02/2021

3M.com/Liqui-Cel